

2008 61st Annual Conference for Protective Relay Engineers

Texas A&M University

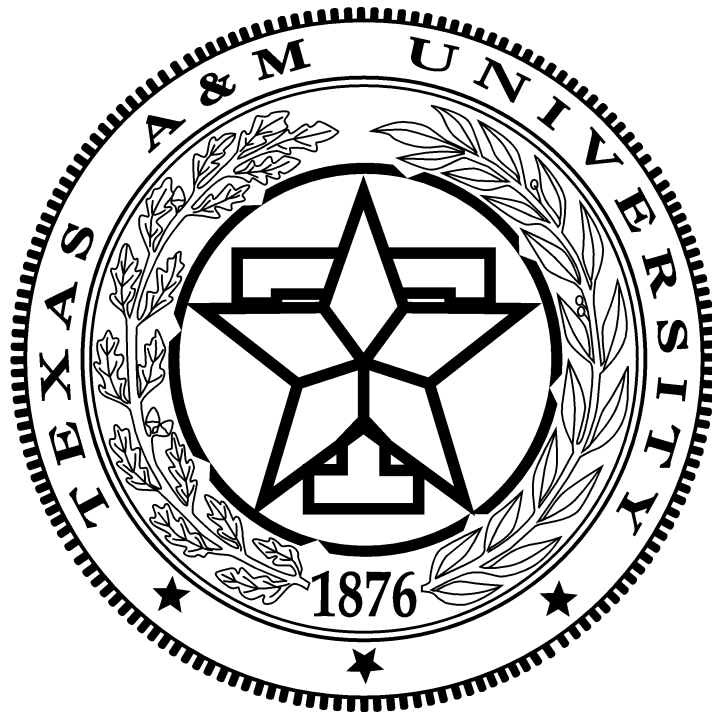


Table of Contents

TUESDAY GENERAL SESSION

FUNDAMENTALS OF DISTANCE PROTECTION.....	1
<i>Bogdan Kasztenny, Dale Finney, General Electric - Multilin</i>	
A REVIEW OF SYSTEM GROUNDING METHODS AND ZERO SEQUENCE CURRENT SOURCES	35
<i>Gerald Johnson, Basler Electric Company; Mark Schroeder, Dominion VA Power; Gerald Dalke, Power System Relay Services</i>	
ENSURING THE CORRECT OPERATION OF DISTANCE RELAYS UNDER DYNAMIC SYSTEM CONDITIONS	72
<i>Alexander Apostolov, Benton Vandiver, OMICRON electronics</i>	
REAL-TIME POWER SYSTEM CONTROL USING SYNCHROPHASORS.....	78
<i>Edmund O. Schweitzer, III, David Whitehead, Schweitzer Engineering Laboratories, Inc.</i>	
ISSUES AND SOLUTIONS IN SETTING A QUADRILATERAL DISTANCE CHARACTERISTIC.....	89
<i>Juergen Holbach, Vythahavya Vadlamani, Yuchen Lu, Siemens</i>	

POWER ENGINEERING TRACK

RELAY ELEMENT PERFORMANCE DURING POWER SYSTEM FREQUENCY EXCURSIONS.....	105
<i>Daqing Hou, Schweitzer Engineering Laboratories, Inc.</i>	
PRACTICAL EXPERIENCE IN SETTING TRANSFORMER DIFFERENTIAL INRUSH RESTRAINT.....	118
<i>Rich Hunt, GE Multilin; Joe Schaefer, Bob Bentert, Florida Power & Light Company</i>	
ANALYSIS OF TRANSFORMER INRUSH CURRENT AND COMPARISON OF HARMONIC RESTRAINT METHODS IN TRANSFORMER PROTECTION.....	142
<i>Jialong Wang, Randy Hamilton, Basler Electric Company</i>	
COMPLEMENTARY APPROACH FOR RELIABLE HIGH SPEED TRANSMISSION LINE PROTECTION	170
<i>Elmo Price, ABB Inc.; Torbjorn Einarsson, ABB AB</i>	
RE-STRIKE AND BREAKER FAILURE CONDITIONS FOR CIRCUIT BREAKERS CONNECTING CAPACITOR BANKS	180
<i>Bogdan Kasztenny, Iliia Voloh, General Electric - Multilin; Alvin Depew, Joseph Wolete, Potomac Electric Power Company; Bruce Pickett, Alan Baker, Mirta Signo-Diaz, Joe Schaefer, John Meinardi, Florida Power & Light Company</i>	

INDUSTRIAL TRACK

APPLICATION CONSIDERATIONS FOR DISTANCE RELAYS ON IMPEDANCE-GROUNDED SYSTEMS.....	196
<i>James Hubertus, Public Service Electric & Gas Company; Joe Mooney, George Alexander, Schweitzer Engineering Laboratories, Inc.</i>	
ENHANCED MOTOR PROTECTION WITH THE SLIP-DEPENDENT THERMAL MODEL: A CASE STUDY	204
<i>Patrick Whatley, Power Plant and Control Systems; Mark Lanier, Lee Underwood, Stan Zocholl, Schweitzer Engineering Laboratories, Inc.</i>	
MOTOR PROTECTION PRINCIPLES.....	215
<i>Craig Wester, Jakov Vico, GE Multilin; Arijit Banerjee, Arvind Tiwari, Global Research Centre - GE India Technology Center</i>	
DISTANCE ELEMENT IMPROVEMENTS – A CASE STUDY.....	232
<i>David Costello, Karl Zimmerman, Schweitzer Engineering Laboratories, Inc.</i>	

Table of Contents

COMMUNICATIONS TRACK

IEEE (ANSI) DEVICE NUMBER 16 – ETHERNET SWITCHES AND ROUTERS.....	247
<i>Eric Udren, KEMA Consulting</i>	

INSIDE THE CLOUD – NETWORK COMMUNICATIONS BASICS FOR THE RELAY ENGINEER.....	273
<i>Solveig Ward, William Higinbotham, Emmanuel Duvelson, RFL Electronics, Inc.; Alisa Saciragic, Maritime Electric</i>	

TUTORIAL: SECURITY IN ELECTRIC UTILITY CONTROL SYSTEMS.....	304
<i>Steven Hurd, Sandia National Laboratories; Rhett Smith, Garrett Leischner, Schweitzer Engineering Laboratories, Inc.</i>	

APPLICATION OF DIGITAL RADIO FOR DISTRIBUTION PILOT PROTECTION AND OTHER APPLICATIONS.....	310
<i>Rich Hunt, Steel McCreery, Mark Adamiak, GE Multilin; Al King, GE MDS</i>	

DIRECTIONAL COMPARISON PROTECTION OVER RADIO CHANNELS FOR SUBTRANSMISSION LINES: FIELD EXPERIENCE IN MEXICO.....	334
<i>Servando Sánchez, Alfredo Dionicio, Martin Monjarás, Manuel Guel, Guillermo Gonzalez, Octavio Vázquez, Comisión Federal de Electricidad, México; José Estrada, Altos Hornos de Mexico S.A.; Héctor Altuve, Ignacio Muñoz, Iván Yañez, Pedro Loza, Schweitzer Engineering Laboratories, Inc.</i>	

WEDNESDAY GENERAL SESSION

FACTORS IN DETERMINATION OF CONTROL DEVICES FOR RECLOSER APPLICATIONS.....	344
<i>Timothy Fahey, ABB Inc.</i>	

DETECTION OF INCIPIENT FAULTS IN UNDERGROUND MEDIUM VOLTAGE CABLES.....	349
<i>Bogdan Kasztenny, Ilia Voloh, General Electric - Multilin; Christopher Jones, George Baroudi, Consolidated Edison Company of New York, Inc.</i>	

PERSPECTIVES ON SUBSTATION DESIGN BASED ON FUNCTIONALITY OF MODERN RELAYS.....	367
<i>Roger Hedding, Sethuraman Ganesan, ABB Inc.</i>	

REAL WORLD EXPERIENCE SUBSTATION HORROR STORY A CONSULTANT’S PERSPECTIV	377
<i>Janusz Dzieduszko, Quanta Technology; Luis Oduber, WEB Aruba</i>	

LESSONS LEARNED ANALYZING TRANSMISSION FAULTS	410
<i>David Costello, Schweitzer Engineering Laboratories, Inc.</i>	

ANALYSIS OF AN AUTOTRANSFORMER RESTRICTED EARTH FAULT APPLICATION	423
<i>Normann Fischer, Derrick Haas, David Costello, Schweitzer Engineering Laboratories</i>	

BREAK-OUT SESSIONS

SYNCHROPHASOR APPLICATIONS OF THE NATIONAL ELECTRIC SYSTEM OPERATOR OF SPAIN.....	436
<i>Santiago López-Barba, Jorge Gómez-Salas, Red Electrica De España; Roberto Cimadevilla, ZIV P+C; Oscar Bolado, ZIV USA, Inc.</i>	

THE IMPORTANCE OF RELAY AND PROGRAMMABLE LOGIC DOCUMENTATION.....	457
<i>Jason Young, Derrick Haas, Schweitzer Engineering Laboratories, Inc.</i>	

COMMISSIONING OF PROTECTIVE RELAY SYSTEMS.....	467
<i>Karl Zimmerman, Schweitzer Engineering Laboratories, Inc.</i>	

PERFORMANCE COMPARISON OF TEST SWITCHES	477
<i>Roy Ball, ABB Inc</i>	

Table of Contents

THE PERFORMANCE OF FAULTED PHASE SELECTORS USED IN TRANSMISSION LINE DISTANCE APPLICATIONS.....	484
<i>Elmo Price, ABB Inc.; Torbjorn Einarsson, ABB AB</i>	
DISTANCE ELEMENT PERFORMANCE UNDER CONDITIONS OF CT SATURATION	491
<i>Joe Mooney, Schweitzer Engineering Laboratories, Inc.</i>	
THURSDAY GENERAL SESSION	
CT FAILURE DETECTION FOR DIFFERENTIAL PROTECTION APPLICATIONS.....	498
<i>Lubomir Sevov, Jorge Cardenas, Yingkai Sun, GE Digital Energy - Multilin</i>	
AUTOMATED EVENT RETRIEVAL REDUCES OPERATING COSTS.....	512
<i>Todd Rosenberger, Oncor Electric Delivery; David Prestwich, Matt Watkins, Mark Weber, Schweitzer Engineering Laboratories, Inc.</i>	
CONTROLLED SWITCHING OF HVAC CIRCUIT BREAKERS: APPLICATION EXAMPLES AND BENEFITS.....	520
<i>Dan Goldsworthy, Tom Roseburg, Bonneville Power Administration; Demetrios Tziouvaras, Jeff Pope, Schweitzer Engineering Laboratories, Inc.</i>	
FAST AND SECURE NUMERICAL BREAKER FAILURE PROTECTION	536
<i>Bogdan Kasztenny, Vijay Muthukrishnan, Dale Finney, Adil Jaffer, General Electric - Multilin</i>	
AN AUTOMATED FAULT LOCATION SYSTEM AS A DECISION SUPPORT TOOL FOR SYSTEM OPERATORS	556
<i>John Vasco, Ravindranauth Ramlachan, Jade Wong, Consolidated Edison Company of New York; Lee Wang, Grid Sentinel Inc.</i>	
DESIGN & IMPLEMENTATION OF AN INDUSTRIAL FACILITY ISLANDING AND LOAD SHED SYSTEM.....	573
<i>Michael Schiefen, Gary Schauerman, BASF; Mark Adamiak, Bernard Cable, General Electric</i>	
FEEDER INTERRUPTIONS CAUSED BY RECURRING FAULTS ON DISTRIBUTION FEEDERS: FAULTS YOU DON'T KNOW ABOUT.....	584
<i>Carl L. Brenner, B. Don Russell, Texas A&M University; Ashok Sundaram, Electric Power Research Institute</i>	
A TUTORIAL ON THE IMPACT OF DISTRIBUTED GENERATION (DG) ON DISTRIBUTION SYSTEMS.....	591
<i>Charles J. Mozina, Beckwith Electric Co., Inc.</i>	